


WattsOn-Mark II Metering Kit (/w MSCT2) Mobilitie / Westell Settings

Detailed commissioning instructions are available in the W2KIT – Installation Instructions document. This document serves to summarize the meter settings specifically for Mobilitie/Westell installations:

Follow the Installation Instructions document for details.

Step Summary:

- Press "Menu"
- Press "Meter Settings"
- Default password is **1234**
- Change the meter settings as per the screen shot below.

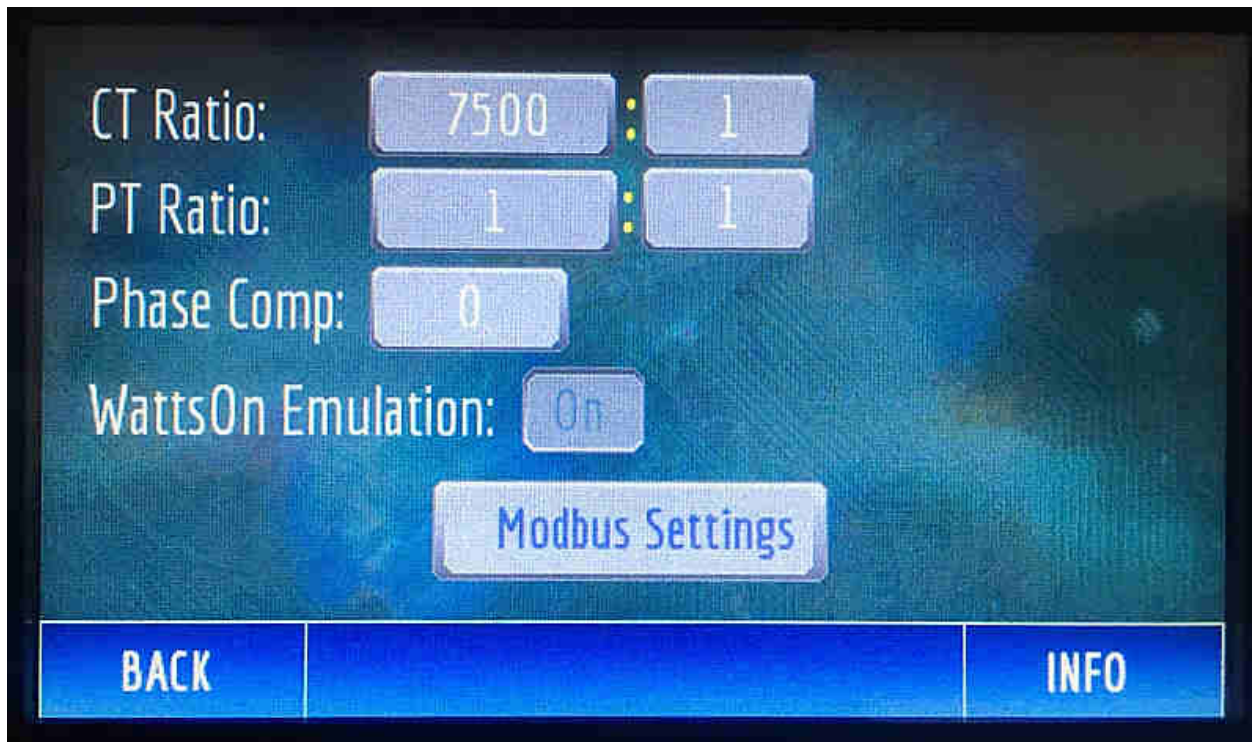

Settings Summary

CT Ratio	7500:1
PT Ratio	1:1
Phase Comp	0
WattsOn Emulation	On

Note: Default Modbus Serial settings are: **9600, N, 8, 1**
Default Modbus Address is **"1"** (set per DIP switch on WattsOn-Mark II meter).